

CLARKSON COMMUNITY CENTRE  
2475 TRUSCOTT DRIVE, MISSISSAUGA, ONTARIO  
SEC PROJ. NO: 2910157-000

FSP-2


**HRT/SCHIRMER**  
an Aon Global company  
335 Renfrew Drive, Suite 101  
Markham, ON, L3R 9S9  
Phone (905) 479-2350 Fax (905) 479-2445  
Fire Protection ■ Code Consulting ■ Risk Assessment ■ Process Safety ■ Security Consulting

DATE: SEPT 10, 2010

SCALE: AS SHOWN

CHECKED BY: L.T.

DRAWN BY: F.H.

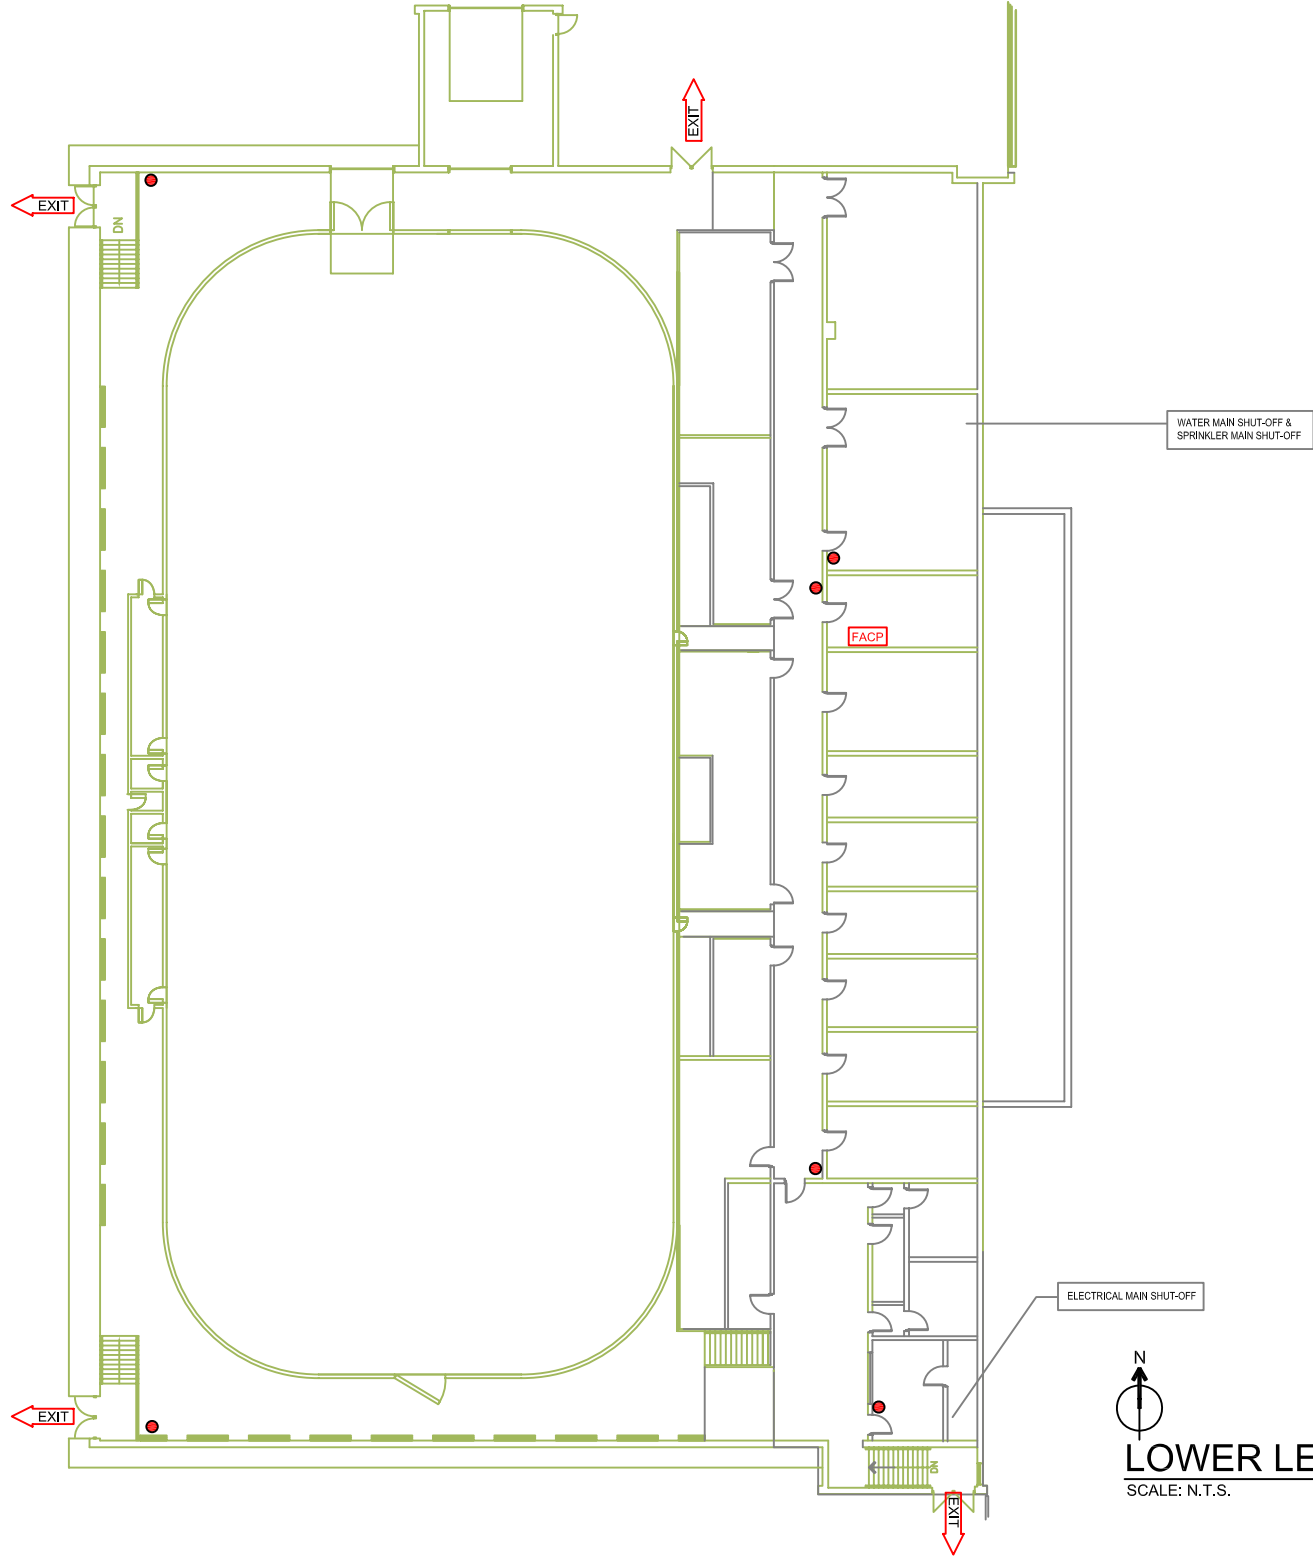

LOWER LEVEL  
SCALE: N.T.S.

- LEGEND**
- MULTIPURPOSE, DRY CHEMICAL PORTABLE FIRE EXTINGUISHER
  - FACP FIRE ALARM AND CONTROL PANEL
  - ANN REMOTE FIRE ALARM ANNUNCIATOR
  - EXIT EXIT

CLARKSON COMMUNITY CENTRE  
2475 TRUSCOTT DRIVE, MISSISSAUGA, ONTARIO  
SEC PROJ. NO: 2910157-000

FSP-3

DATE: SEPT 10, 2010 SCALE: AS SHOWN

CHECKED BY: L.T.

DRAWN BY: F.H.

**HRT/SCHIRMER**  
an Aon Global company

335 Renfrew Drive, Suite 101  
Markham, ON, L3R 9S9  
Phone (905) 479-2350 Fax (905) 479-2445

Fire Protection ■ Code Consulting ■ Risk Assessment ■ Process Safety ■ Security Consulting