

## **ADDENDUM 1**

### **00 91 13**

*The information listed below is to form part of the Contract Documents. All associated costs are to be included in Tender Price shown on Tender Form. Acknowledgment of this Addendum, by number, to be shown in space provided on Tender Form.*

#### **1 MECHANICAL DRAWINGS**

##### **1.1 Drawing M-201 – Mechanical Riser Diagrams and Schedules (Re-issued)**

- .1 Revise plumbing fixture connection schedule.
- .2 Revise domestic water riser diagram.

##### **1.2 Drawing M-301 - Plumbing 4<sup>th</sup> Floor Plan (Not re-issued)**

- .1 Revise the sizing of the new CW and HW branches to 25mm.

END OF ADDENDUM

**END OF SECTION**

**PRELIMINARY**  
NOT FOR CONSTRUCTION

D1	09.09.24	ISSUED FOR ADDENDUM 01
D	06.06.24	ISSUED FOR TENDER
C	05.30.24	ISSUED FOR PERMIT
B	05.13.24	ISSUED FOR 75% CD
A	04.15.24	ISSUED FOR 100% DD
REF	DATE	DESCRIPTION

## DRAWINGS ARE NOT TO BE SCALED

CONSTRUCTION MUST CONFIRM TO ALL APPLICABLE CODES  
AND REQUIREMENTS OF THE AUTHORITIES HAVING  
JURISDICTION.

CONTRACTOR MUST VERIFY AND ACCEPT RESPONSIBILITY FOR ALL DIMENSIONS AND CONDITIONS ON SITE AND SHALL NOTIFY THE APPROPRIATE CONSULTANT OF DISCREPANCIES WITH OR VARIATIONS FROM THE INFORMATION PROVIDED BEFORE PROCEEDING WITH THE WORK.

THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION  
UNLESS SPECIFICALLY ISSUED "FOR CONSTRUCTION" OR  
OTHERWISE CONFORMING TO THE DRAWINGS THAT FORM THE  
BASIS FOR WHICH A BUILDING PERMIT FOR THE PROJECT HAS  
BEEN ISSUED.

ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE ARCHITECT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS IN PART OR IN WHOLE IS FORBIDDEN WITHOUT THE ARCHITECT'S WRITTEN PERMISSION.

UTM PROJECT NO. P300-23-095

UNIVERSITY OF TORONTO MISSISSAUGA  
TERRENCE DONNELLY HEALTH SCIENCES COMPLEX  
777 OUTER CIRCLE, MISSISSAUGA ON L5L 1C6

VAN ELSLANDER AND ASSOCIATES ARCHITECT  
VEARCHITECTS.CA (416) 593 1142 18 HOOK AVE., UNIT 201 TORONTO, ON




Entered: 15


Checked: ADJ  
Plot: 2024-09-09

13970

M-201

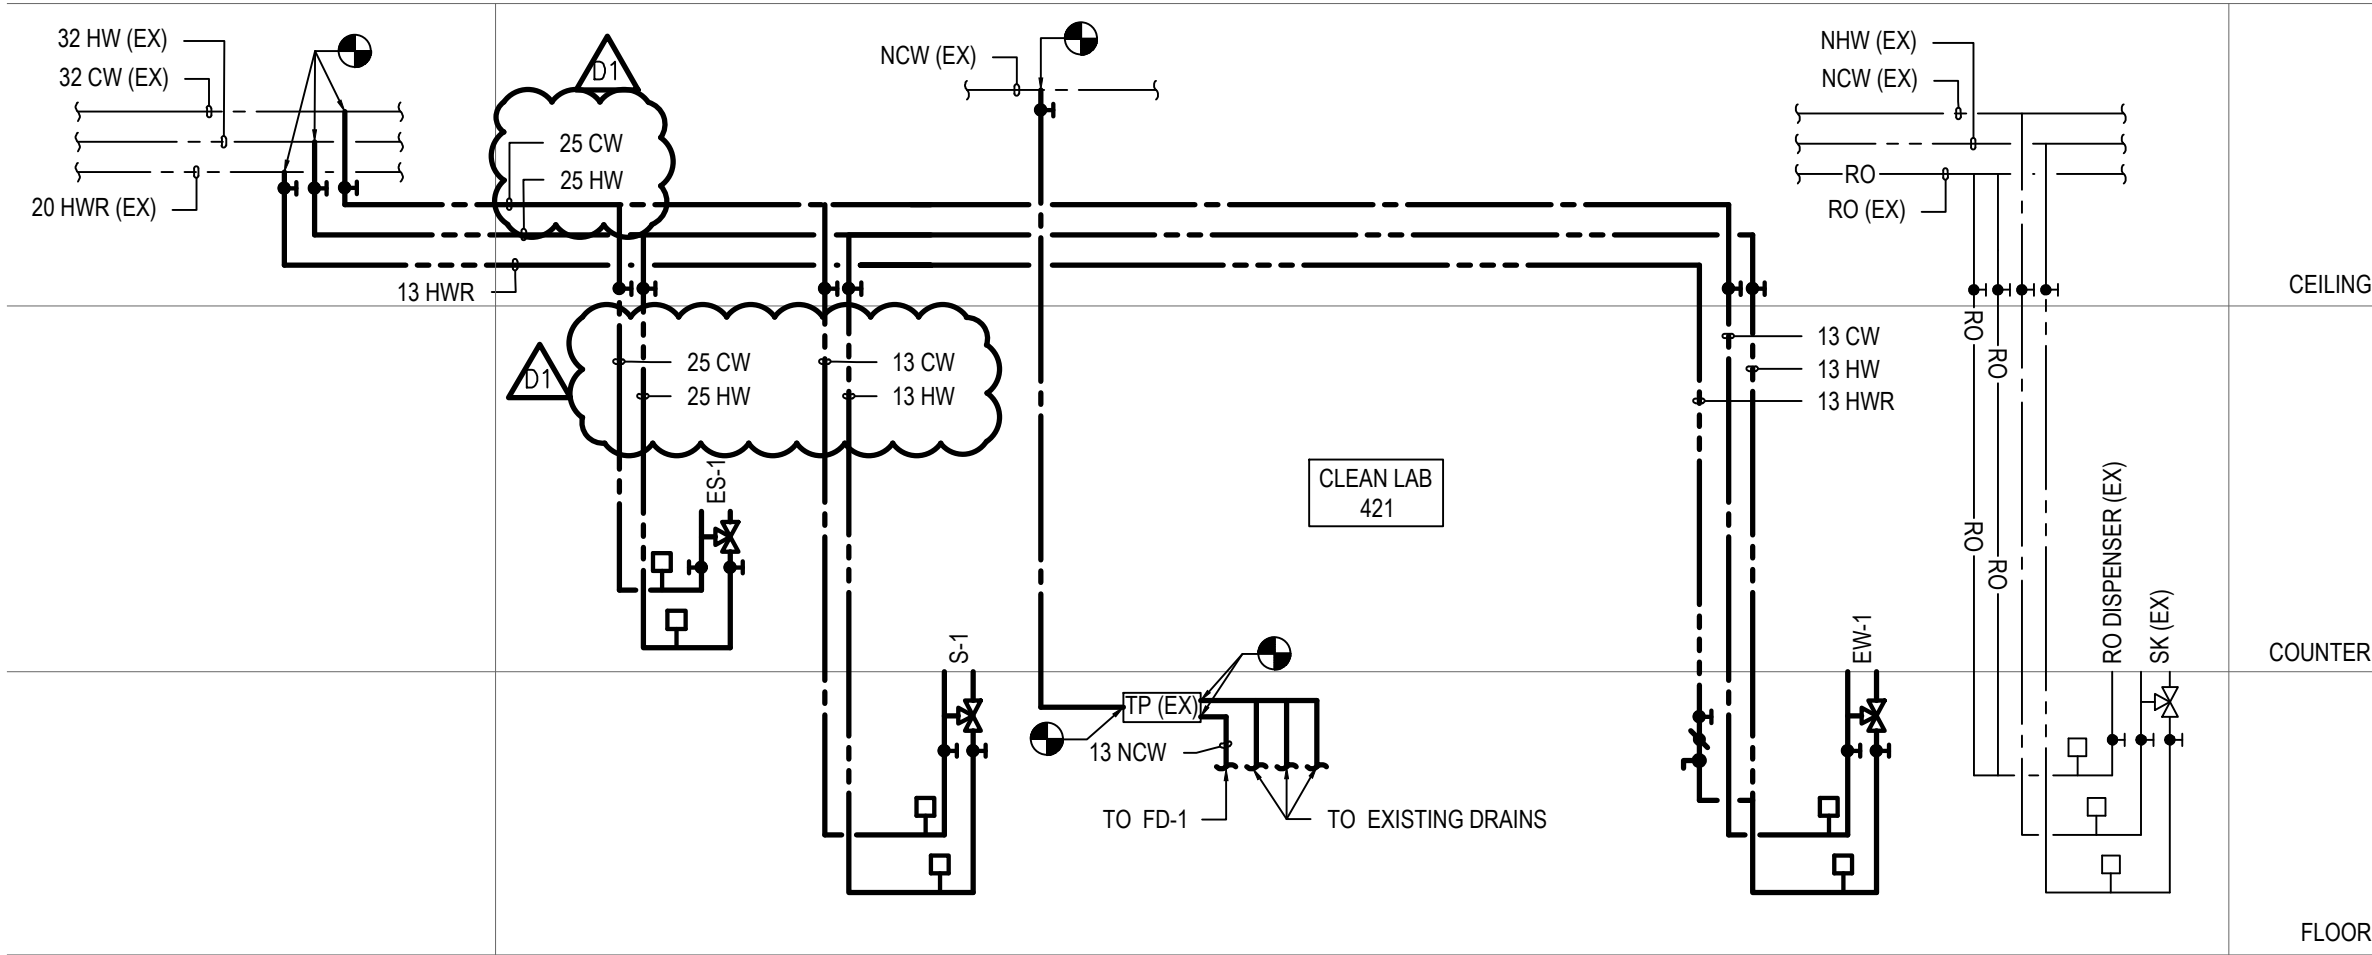

2 DOMESTIC WATER RISER DIAGRAM  
M-201 N.T.S.

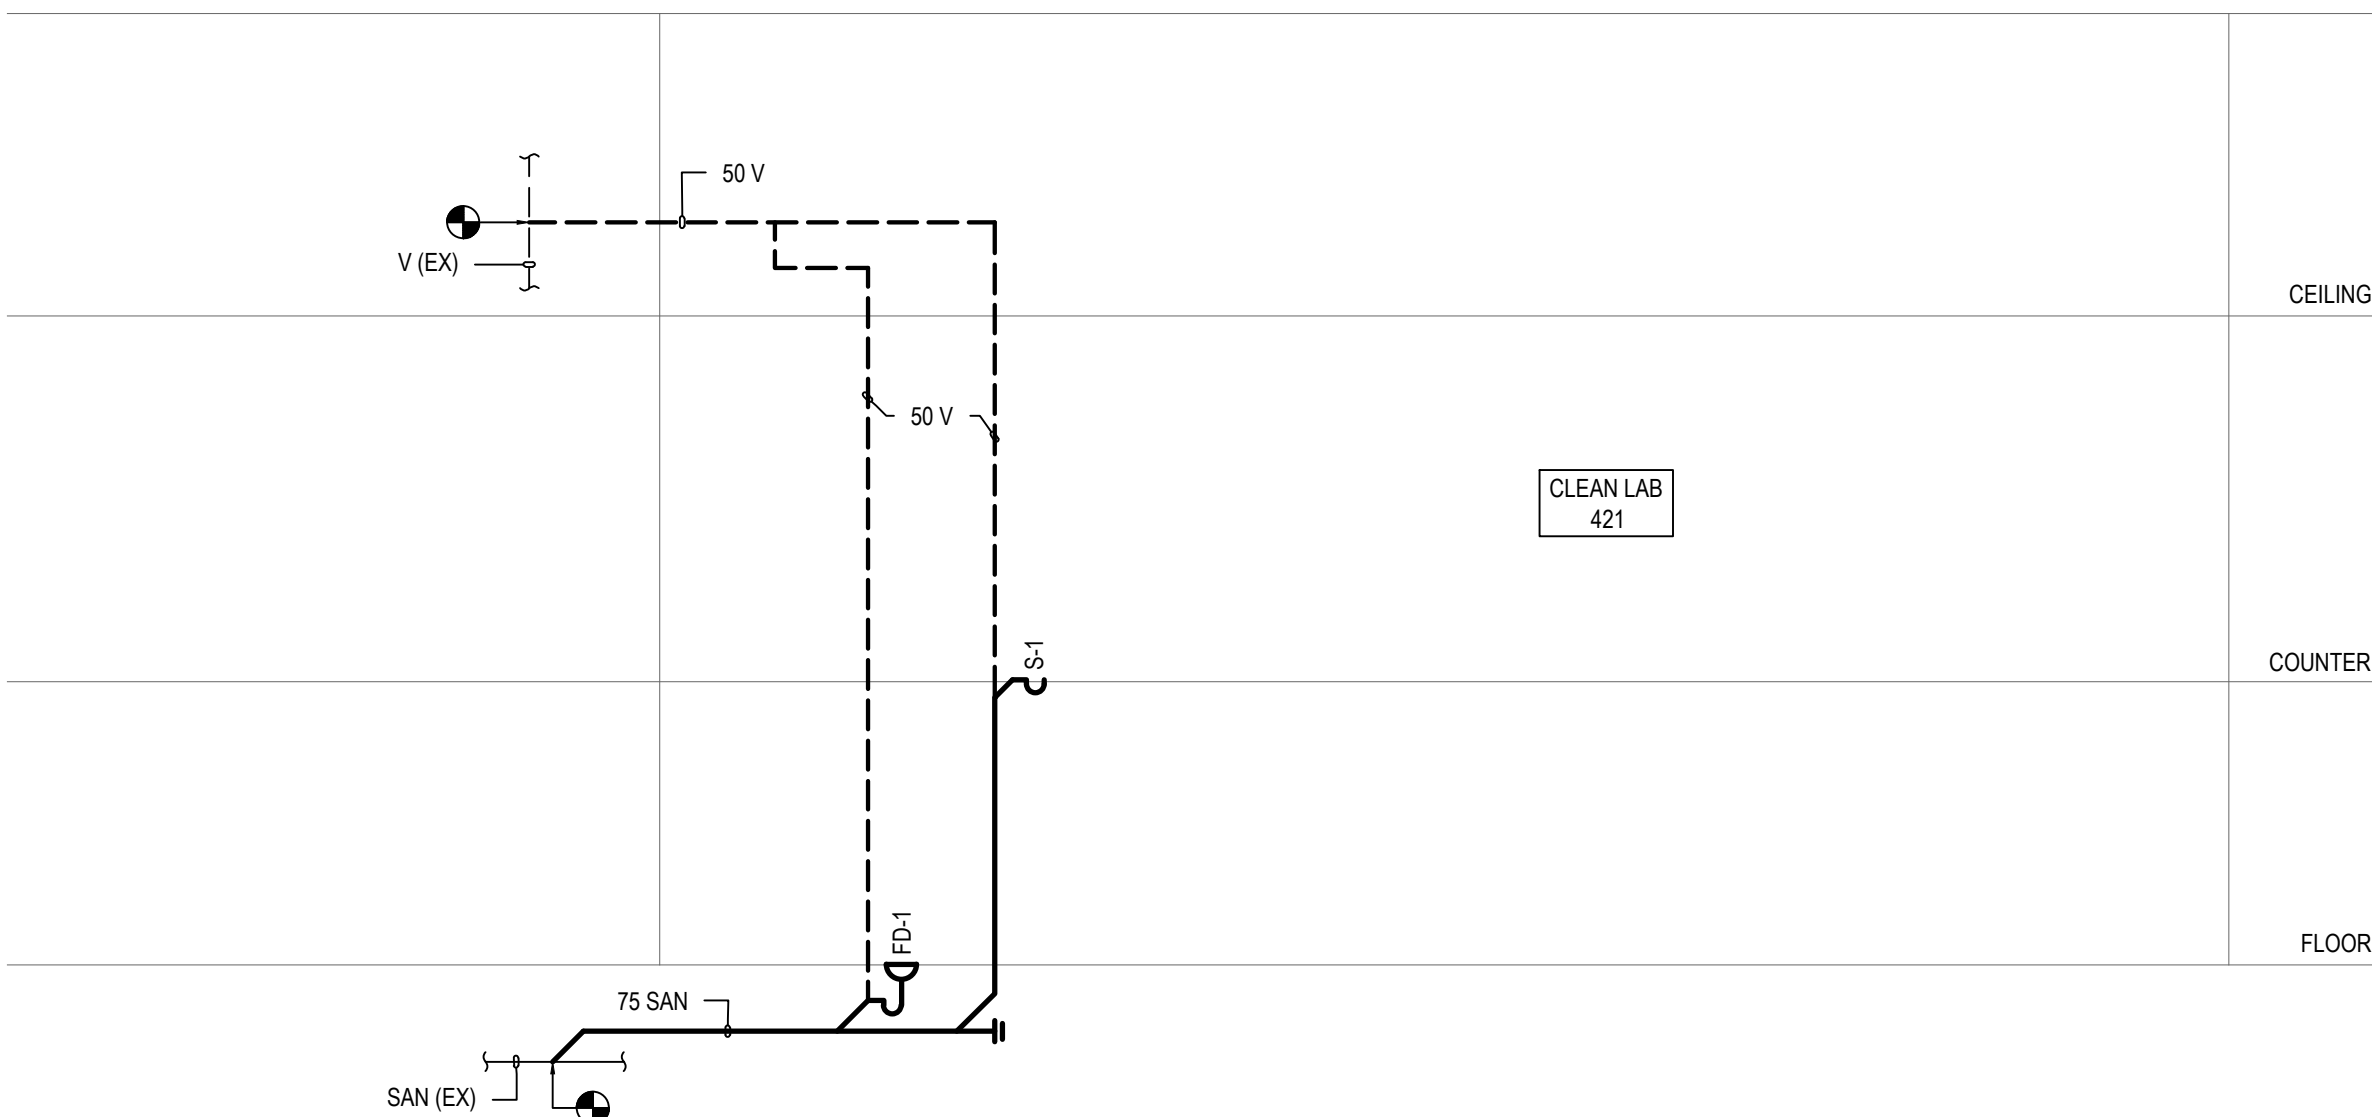

1	SANITARY RISER DIAGRAM
M-201	N.T.S.

NOT USED

4 DETAIL - NOT USED  
M-201 N.T.S.

PLUMBING FIXTURE CONNECTION SCHEDULE									
TAG	DESCRIPTION	WASTE	VENT	CW	HW	RWR	NCW	REMARKS	
ES-1	EMERGENCY SHOWER	-	-	25 MM	25 MM	-	-	PROVIDE AND INSTALL THERMOSTATIC VALVE BELOW COUNTER AND SET TO 35°C. SEE RISER DIAGRAM FOR PIPING SCHEMATIC.	
EW-1	EYEWASH STATION	-	-	13 MM	13 MM	13 MM	-	PROVIDE AND INSTALL THERMOSTATIC VALVE BELOW COUNTER AND SET TO 28°C. SEE RISER DIAGRAM FOR PIPING SCHEMATIC.	
S-1	SINK	50 MM	50 MM	13 MM	13 MM	-	-	PROVIDE AND INSTALL THERMOSTATIC VALVE BELOW COUNTER AND SET TO 43°C. SEE RISER DIAGRAM FOR PIPING SCHEMATIC.	
FD-1	FLOOR DRAIN	75 MM	50 MM	-	-	-	-	PROVIDE CW CONNECTION AND ROUTE TO ELECTRONIC TRAP PRIMER.	
TP	TRAP PRIMER	-	-	-	-	-	13 MM	SEE RISER DIAGRAM FOR PIPING SCHEMATIC.	

NOTES:  
1. UNLESS OTHERWISE NOTED, SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS

AIR INLETS AND OUTLETS SCHEDULE								
TAG	SERVICE	MAX AIRFLOW (LPS)	FACE SIZE (MM)	NECK SIZE (MM)	BORDER TYPE	NOISE CRITERIA AT MAX CFM (NC)	MAKE / MODEL	REMARKS
EG-A	EXHAUST GRILLE	0-115	400 X 150	-	-	20	E.H. PRICE / 530	SEE NOTES

NOTES:

1. DIFFUSER COLOUR/FINISH TO BE COORDINATED WITH ARCHITECT.
2. VOLUME DAMPERS 3 FEET MIN. FROM GRILLES.
3. FOR DUCTED EXHAUST/RETURN REGISTERS, PROVIDE MIN. 4" DEEP PLENUM, TRANSITION TO REGISTER COLLAR/NECK OPENING SIZES INDICATED FOR DUCT CONNECTIONS

3	MECHANICAL SCHEDULE
M-201	N.T.S.