

Date: January 29, 2025

(4 pages)

**ADDENDUM NO. 3**

**Request for Proposal Call No. RFP2024-418**  
**CONSTRUCTION OF THE FIELD HOCKEY & MULTISPORT TRAINING DOME,**  
**COMFORT STATION AT THE CASSIE CAMPBELL COMMUNITY CENTRE**

---

This Addendum forms part of the Bid/Proposal Document.

**1. Pertaining to Tables 1.2.4 KEY PERSONNEL TEAM ORGANIZATION & QUALIFICATIONS**

**DELETE the following.**

In the table below, indicate the personnel and their role from your company that are to be assigned to this contract. At a minimum, the proposed key personnel should include a Project manager and a Site supervisor. Both the Project Manager and Site Supervisor must have completed five projects, each with a construction value over five (5) Million Dollars in the past ten (10) years.

**REPLACE WITH.**

In the table below indicate the personnel and their role from your company that are to be assigned to this contract. At a minimum, the proposed key personnel should include a Project manager and Site Supervisor. Both the Project Manager and Site Supervisor must have completed five projects, each with a construction value over two (2) Million Dollars in the past ten (10) years.

**ADD**

**The following to Table has been added as 1.2.4 B Subcontractor Qualifications**

In addition, the General Contractor may include in the table below, the **Prime Contractor's subcontractors** and their roles within the project.

Sub-Contractors (Installers) must be able to clearly demonstrate that they have the expertise, experience and qualifications to complete their portion of the project and must have completed five projects, in the past 10 years.

In Step 4 Documents, **Attachment G** – Sub-Contractors identified in the table below must include **Project Sheets**, for all five projects that identify all relative information demonstrating similar scope as described in this RFP. Include number of projects completed with the Prime Contractor.

There shall be no substitution of sub- contractors without prior written approval of the City's designated Project Manager.

In the table below, provide information for each sub-contractor. Click on button “Add Optional Row” to add additional rows if required.

Line Item	Name of the Sub-Contractor.	Sub-Contractor’s Role in the Project.	
1			*
2			*
3			*
4			*
5			*
6			*
7			*
8			*
9			*
10			*

## 2. Questions and Answers:

**Q1: Refer: AV601. The drawing indicates that each paging horn/speaker within the dome (playing field) to be connected to an**

**independent channel of amplification. This appears unusual approach for this space. Typically loudspeakers would be grouped into circuits dependent on wattage loading and available power amplification.**

**Since the dome area is one open space (one zone) please provide clarity on the need for each horn speaker circuited back to the power amplifier. To greatly save cost of equipment and labour will CoB accept that the Dome area be considered a single PA Zone with 2 groups of PA Horn circuits (5 horns x 2 circuits).**

A1: Review the revised drawing AV601 Rev 2 01.27.25

All other terms and conditions remain unchanged.

If you have any questions, please do not hesitate to contact the undersigned.


**Bidders are required to acknowledge all Addenda.**

Name: Santosh Mishra

Title: Senior Buyer

Ph: (905) 874-3482

Email: santosh.mishra@brampton.ca

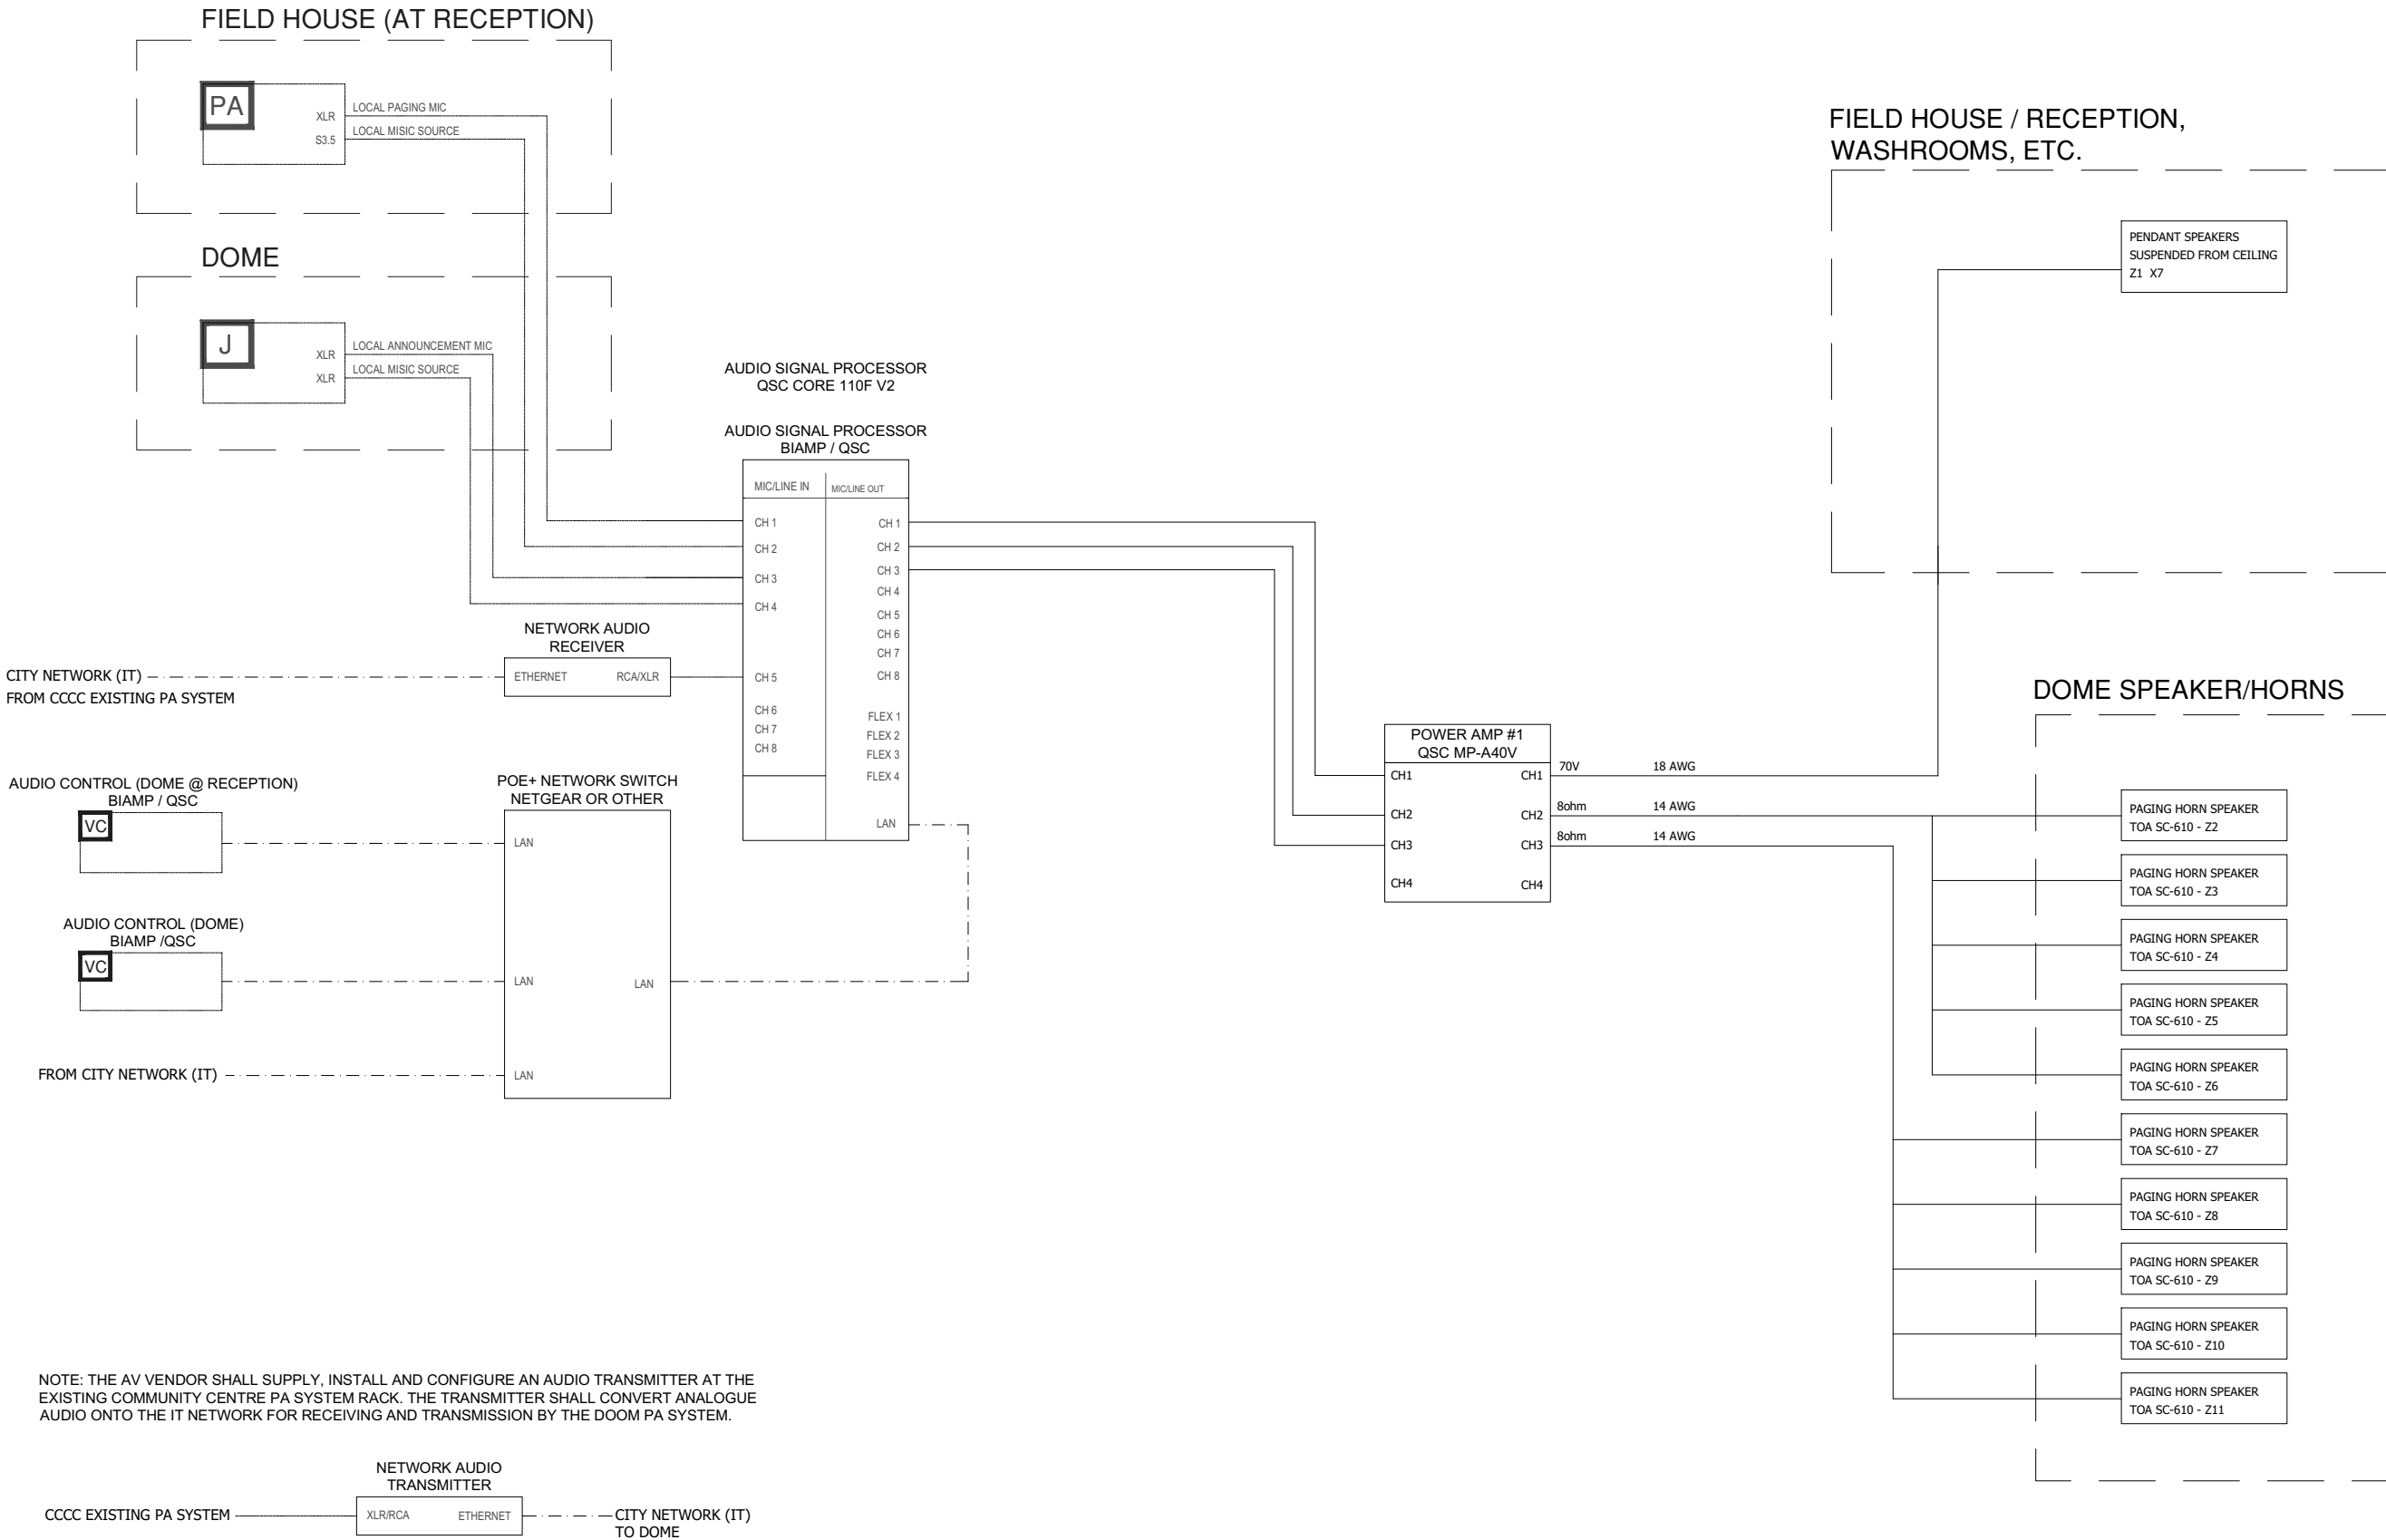

NO.	DATE.	REVISION
1	12/3/24	FOR REVIEW
2	01/27/25	FOR COORDINATION

CASSIE CAMPBELL  
COMMUNITY CENTRE DOME

1610 SANDALWOOD PKWY  
BRAMPTON, ON

PA SYSTEM CONCEPTUAL  
FUNCTIONAL BLOCK  
DIAGRAM

DRN BY	EH
REVIEW BY	RN
SCALE	DO NOT SCALE
DATE	3-NOV-2024
PROJECT #	02215

AV601

NOT FOR CONSTRUCTION

RFP 2024-418- ADDENDUM # 3