NOTES:

1. EXISTING PANEL 'PP-2BP' IS 225A, 120/208V, 304W.CUTLER-HAMMER JOB NO. 24B857200. PROVIDE ONE (1) NEW 20A/1P CIRCUIT BREAKER FOR ALL NEW ROOFTOP MAINTENANCE RECEPTACLES




2 NEW CONSTRUCTION - ELEC - ROOF PLAN
E101 SCALE: 1:200

GENERAL NOTES:

1. FOR EACH MECHANICAL EQUIPMENT SHOWN TO BE REMOVED, DISCONNECT UNIT AND REMOVE ALL ASSOCIATED FEEDERS, CONDUITS, AND SUPPORTS BACK TO SOURCE. REMOVAL OF MECHANICAL EQUIPMENT BY MECHANICAL CONTRACTOR.

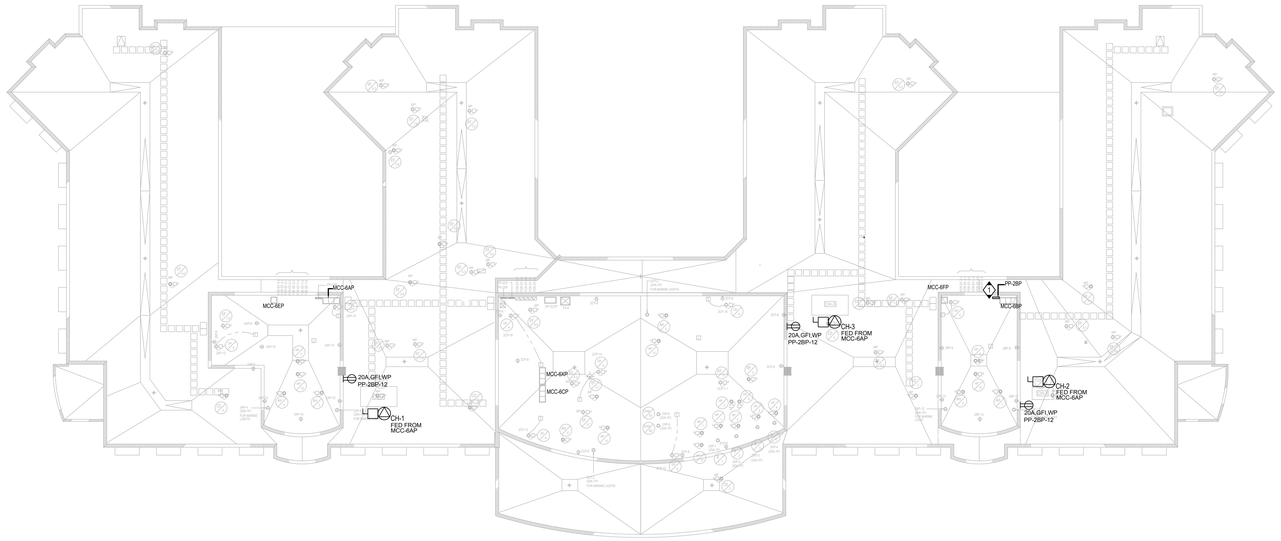


1 DEMOLITION - ELEC - ROOF PLAN
E101 SCALE: 1:200

exp.
t: 905.695.3217 | f: 905.695.0167
220 Commerce Valley Drive West, Suite 110
Markham, ON L3T 0A8
Canada
www.exp.com

- BUILDINGS
- ENERGY
- INFRASTRUCTURE
- EARTH & ENVIRONMENT
- INDUSTRIAL
- SUSTAINABILITY

**Issued**
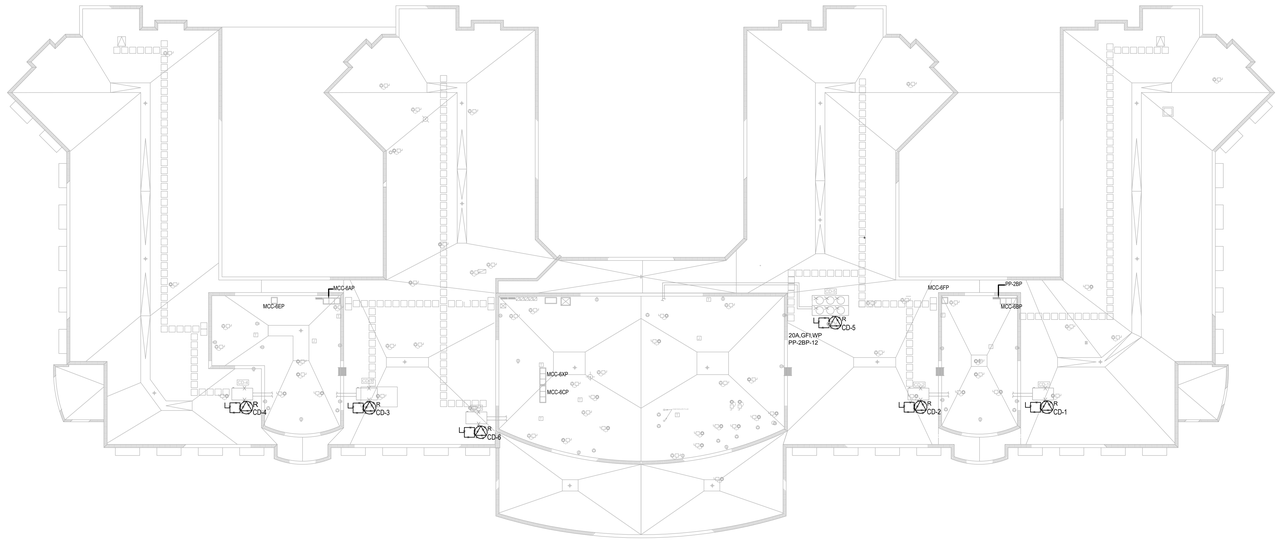
| No. | Date | Description |
|---|---|---|
| 1 | 2024-11-08 | ISSUED FOR PERMIT / TENDER |
| 2 | 2024-02-21 | ISSUED FOR ADDENDUM #2 |

PROJECT NORTH
TV RIDE

Contractor Must Check & Verify all Dimensions on the Job.

Do Not Scale Drawings.

All Drawings, Specifications and Related Documents are the Copyright Property of the Architect and Must be Returned Upon Request. Reproduction of Drawings, Specifications and Related Documents in Part or in Whole is Forbidden Without the Written permission of the Architect.

This Drawing is Not to be Used for Construction Until Signed by the Architect.

WESBURN MANOR LTC
AHU REPLACEMENT

**ELECTRICAL ROOF PLAN**

N.T.S.

# E101