



## ADDENDUM

Head Office: 2902 South Sheridan Way, Suite 300, Oakville, ON L6J 7L6 Tel: (905) 274-7556 Fax: (905) 274-5382

To: **City of Toronto**  
Project Management Office  
Corporate Real Estate Management Division  
Metro Hall  
55 John Street, Toronto, ON M5V 3C6

Ref No.: **6915**

Date: **Apr. 22, 2025**

ADDENDUM NO.: **01**

**Attn: Helen Lyronis**

From: Tyler Davie, P. Eng.

**RE: FIRE STATION NO. 243  
SITE, VENTILATION AND FIRE ALARM SYSTEM UPGRADES**

This addendum refers to additions, deletions, modifications and clarifications which hereby become an integral part of the original Contract Documents and shall be read in conjunction with the same.

No consideration will be allowed for extras to the Contract due to the contractors, or sub-contractors, not being familiar with this Addendum. Acknowledgment of receipt of this Addendum is to be given in the space provided on the Tender document.

### **DESCRIPTION:**


1. Reference Drawing C3, "Civil – Phase II – Driveway Asphalt Paving Replacement Layout, Notes, Details"
  - .1 Refer to revised drawing Revision 3 - Issued for Addendum No. 1, Dated Apr. 22, 2025.
  - .2 Revised grading and slope around existing natural gas generator concrete foundation.
  - .3 Added swale around existing natural gas generator concrete foundation.
  - .4 Added swale detail.
2. Reference Drawing E2, "Electrical Site Plan and Details"
  - .1 Refer to revised drawing Revision 3 - Issued for Addendum No. 1, Dated Apr. 22, 2025.
  - .2 Added supervised valve. This valve shall be designated fire alarm connection no. 07 (FAC-7).
3. Reference Drawing E4 "Electrical First Floor Proposed Plan"
  - .1 Refer to revised drawing Revision 3 - Issued for Addendum No. 1, Dated Apr. 22, 2025.
  - .2 Revised description of AHU fire alarm system connections from 'AHU Duct Smoke' to 'AHU Fire Alarm System Shutdowns FAC-8 and FAC-9'.
  - .3 Added detail for fire alarm shutdown of AHUs.
4. Reference Drawing E5, "Electrical Fire Alarm System Riser Diagram, Schematic and Schedule"
  - .1 Refer to revised drawing Revision 3 - Issued for Addendum No. 1, Dated Apr. 22, 2025.
  - .2 Added supervised valve. This valve shall be designated fire alarm connection no. 07 (FAC-7).

END OF ADDENDUM







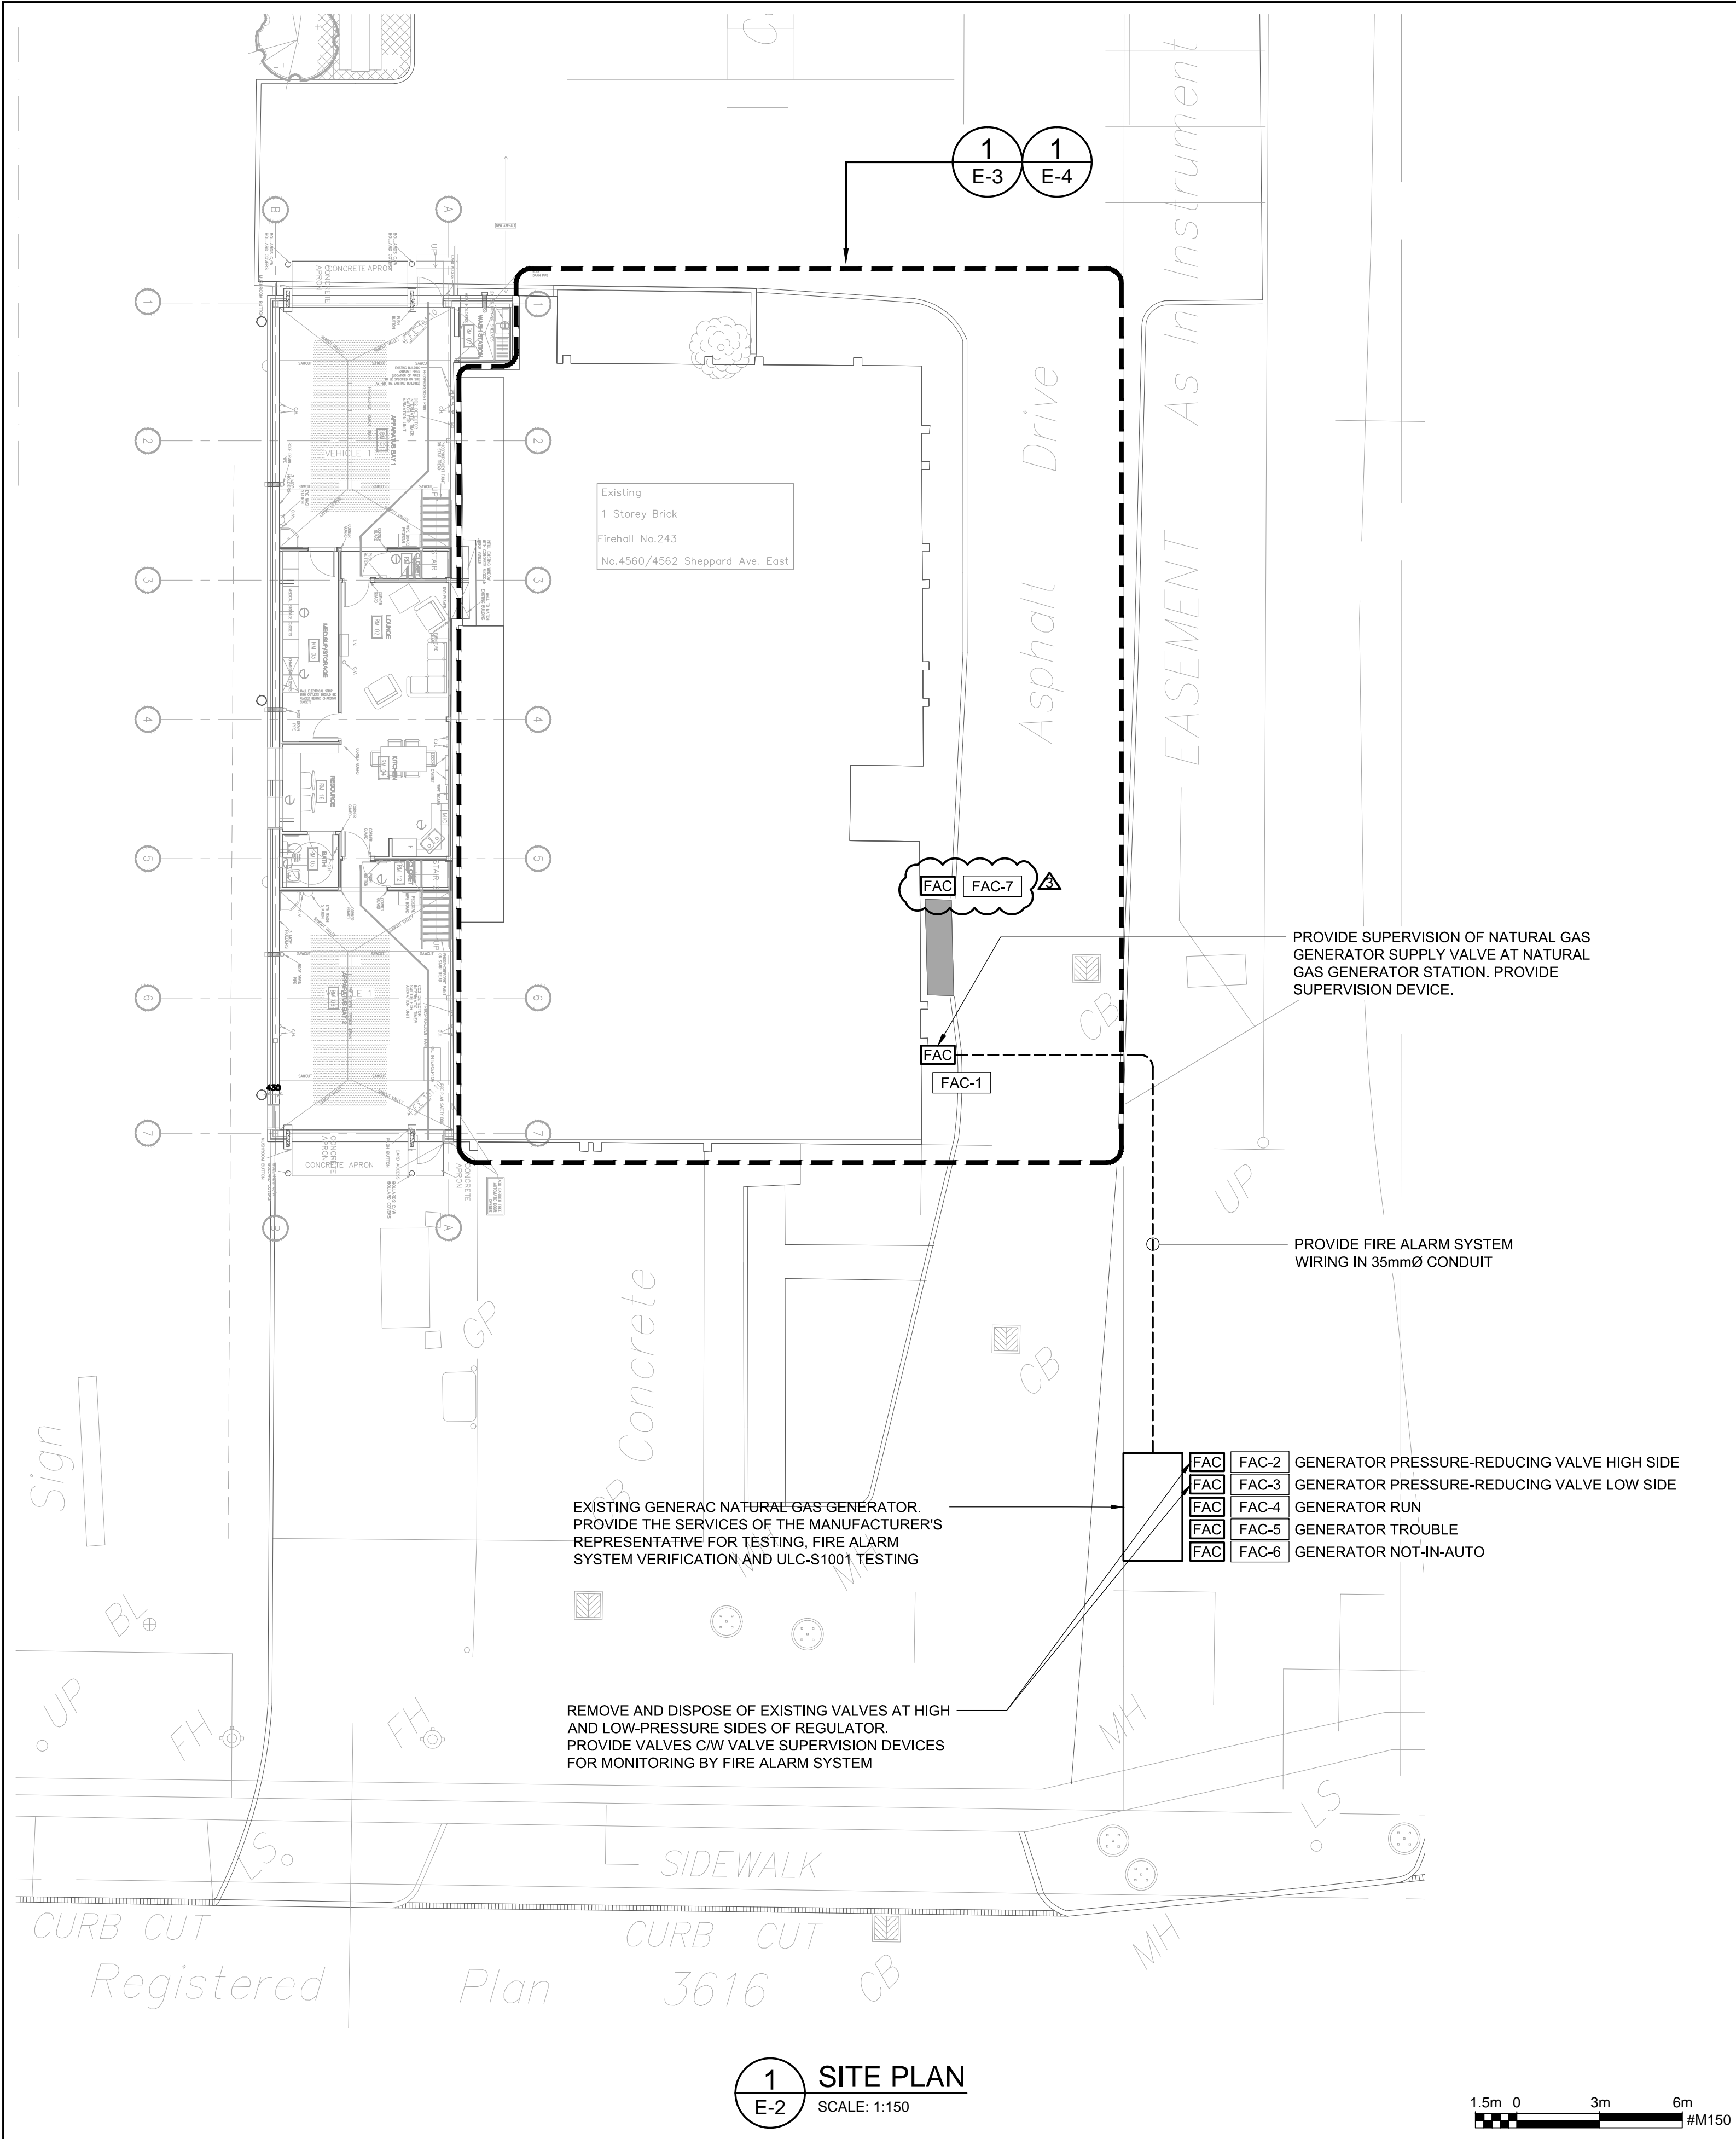

CONSULTANT

**Moon-Matz Ltd.**  
Consulting Engineers  
2902 SOUTH SHERIDAN WAY,  
SUITE 300  
OAKVILLE ON L6J 7L6  
TEL: (905)274-7556  
FAX: (905)274-5382  
E-mail: info@moon-matz.com

**Toronto**  
CITY OF TORONTO

TITLE  
**FIRE STATION 243 UPGRADES**  
**4560 SHEPPARD AVE E,**  
**TORONTO ON**

**ELECTRICAL**  
**SITE PLAN AND DETAILS**

DATE: APRIL 2024  
FILE NO.: 6915-E-2

SCALE: AS SHOWN  
DRAWING NO.: E-2



